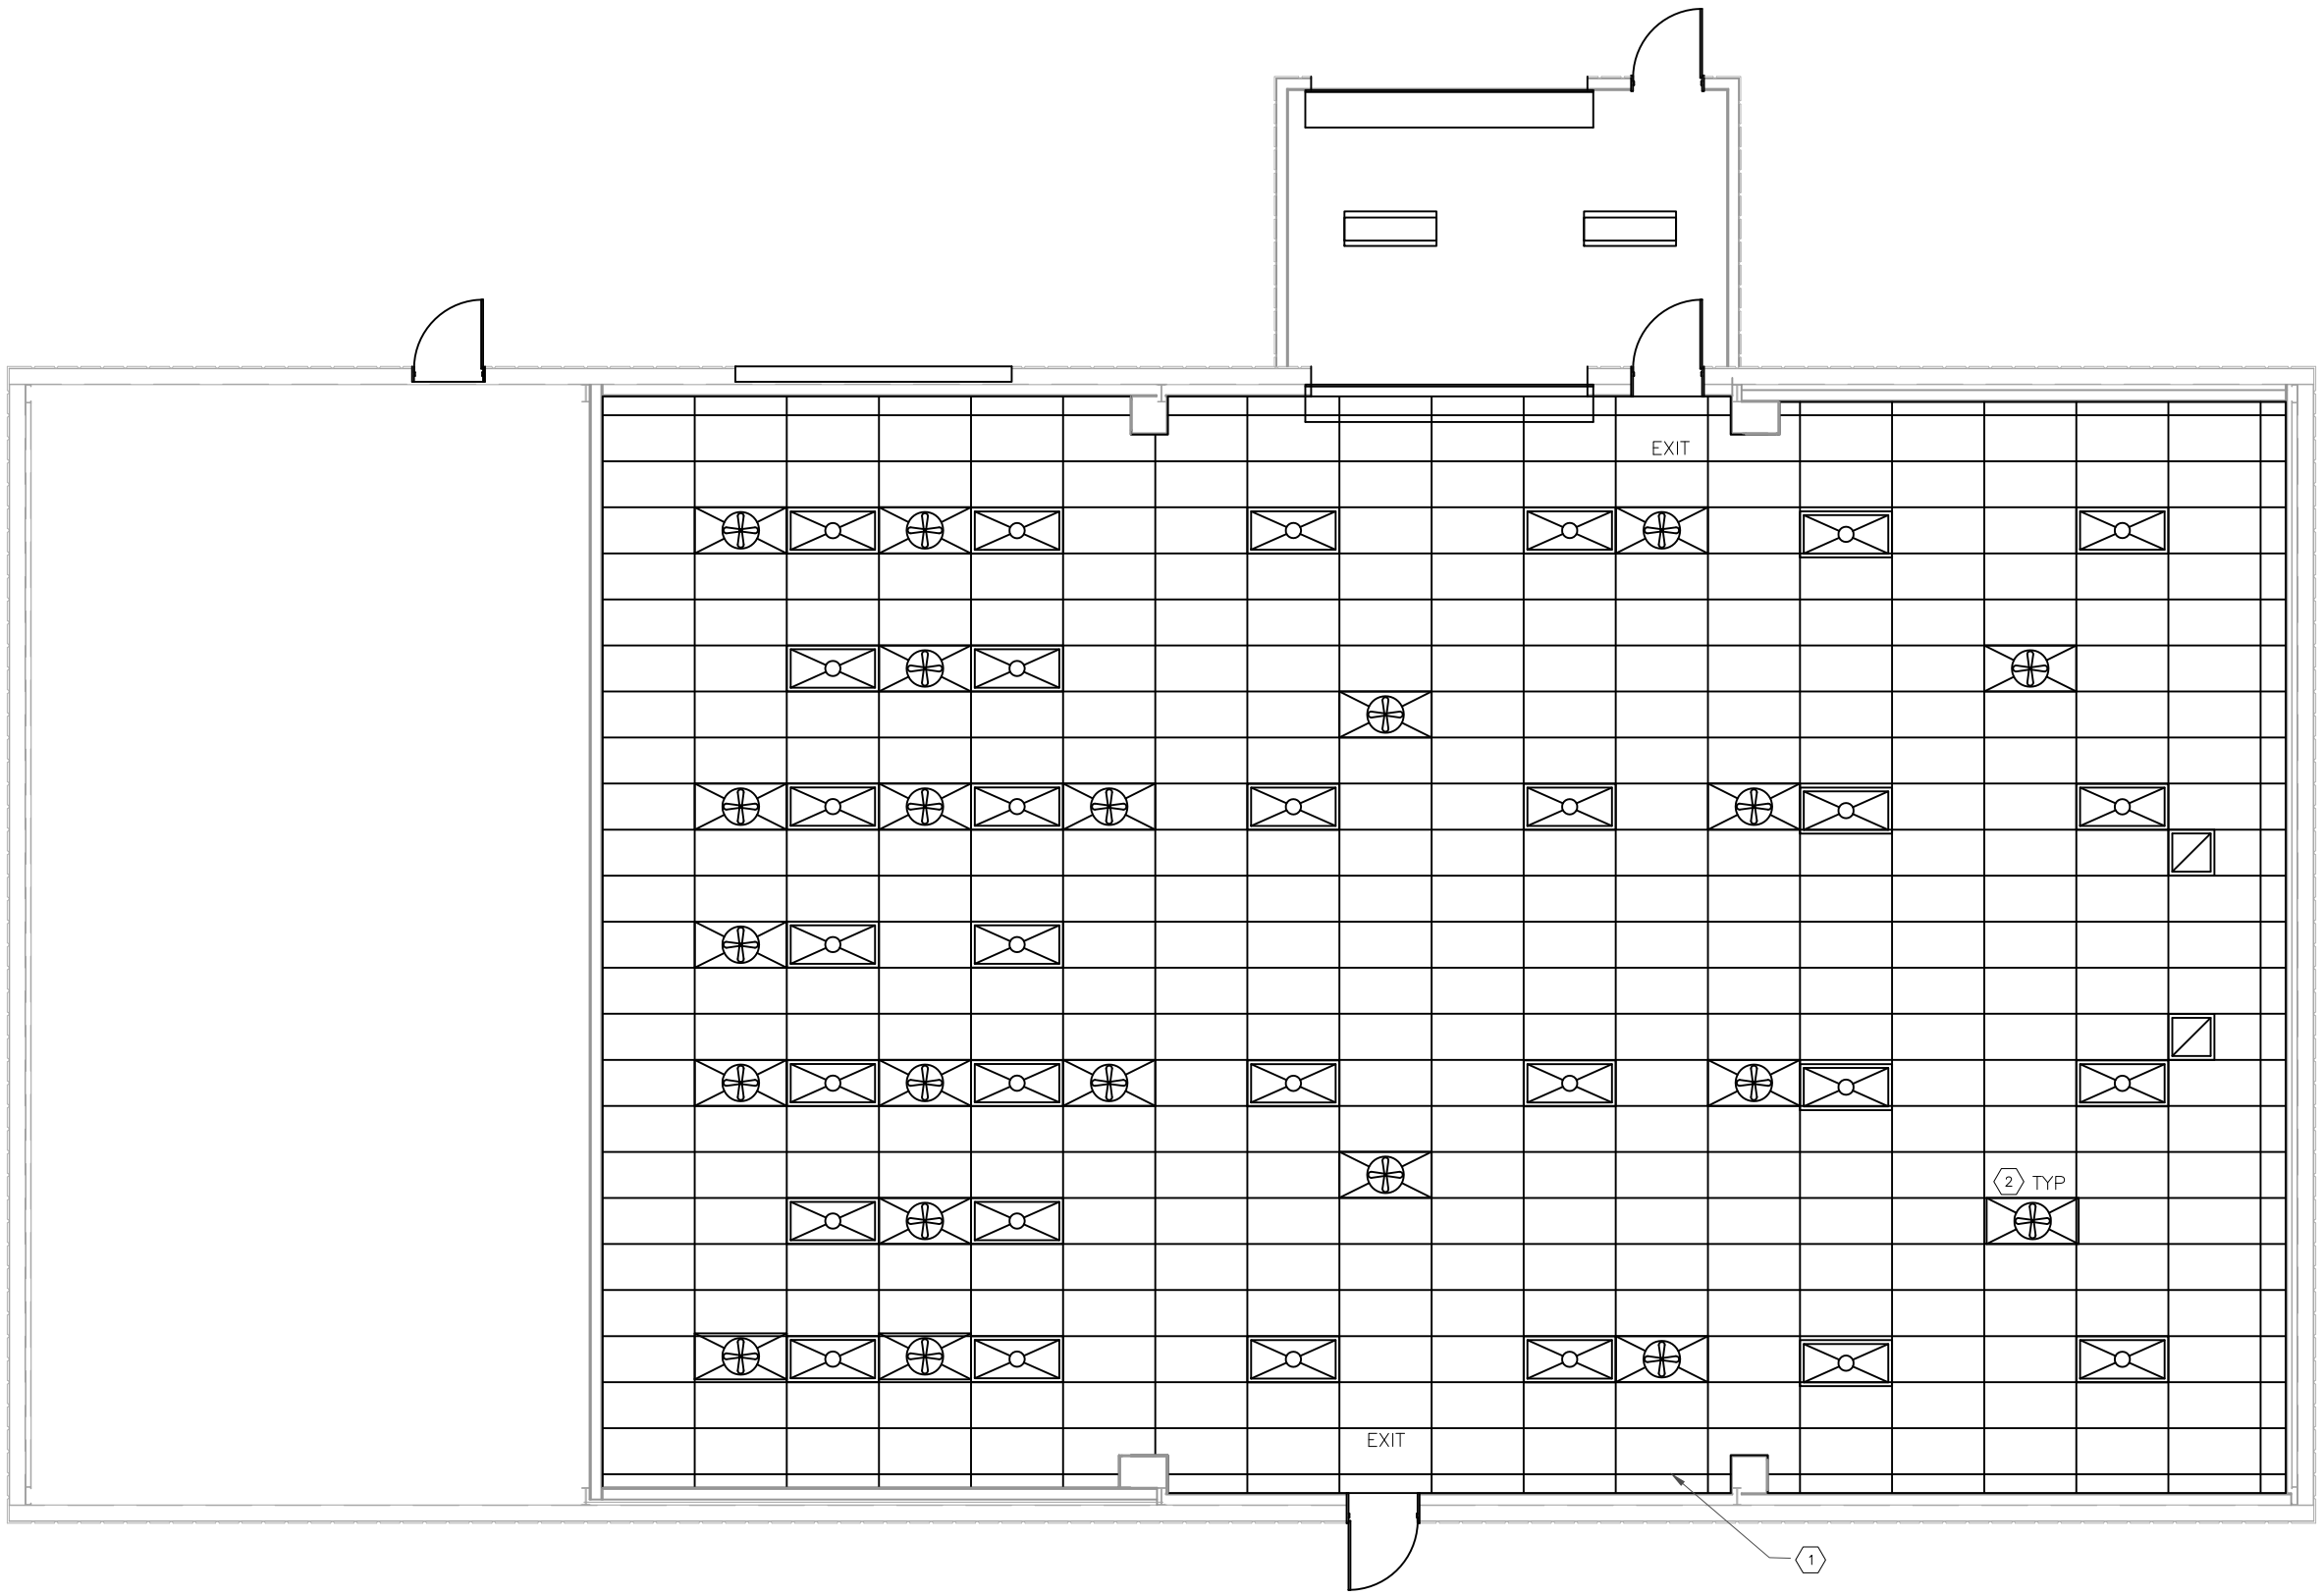

REFLECTED CEILING PLAN

SCALE: 1/4" = 1'-0

0 4' 8'

SCALE IN FEET

LEGEND

	FAN/FILTER UNIT, PF-1
	4'-0"x2'-0" FLUORESCENT LIGHT FIXTURE, (SEE E1.1)
	4' SURFACE MOUNT LIGHT FIXTURE (SEE E1.1)
EXIT	EXIT LIGHT
	4'-0"x2'-0" SUSPENDED ACOUSTICAL TILE CEILING.
	RETURN AIR GRILLE

CONSTRUCTION NOTES

1. INSTALL SUSPENDED CEILING AT 12'-2" ABOVE FINISHED FLOOR. SUSPENDED TILE SHALL BE VINYL COATED OR ACRYLIC/PVC FOR CLEAN ROOM ENVIRONMENTS.
2. SUPPORT FILTER/FAN UNITS FROM STRUCTURE USING SUPPORT WIRE AND MASON INDUSTRIES WHR40 RUBBER CEILING HANGERS.

REV NO.	DATE	BY	DESCRIPTION	DATE OF ISSUE	APPROVED
				12/16/2008	

GILBERT L. HIBBS
STATE OF WASHINGTON
25649
REGISTERED
PROFESSIONAL ENGINEER

EXPIRES 10/31/09

© 2008 Hibbs Engineering, Inc.

DRAWN BY: GLH
CHECKED BY:
DESIGN A/E
DESIGN GM
HEI APPROVAL

LHO WAREHOUSE
REFLECTED CEILING PLAN

PROJECT NUMBER: 1023.010
CAD FILE: 0000A01.DWG

LIGO HANFORD OBSERVATORY
DRAWING: LIGO-D0810023-V1

HIBBS ENGINEERING, INC.
KENNEWICK, WASHINGTON

DRAWING NUMBER 023
REV V1

PRINTED BY: Gilbert Hibbs Office on 12/17/2008 5:11 PM