



LDAS Room, Lab Building

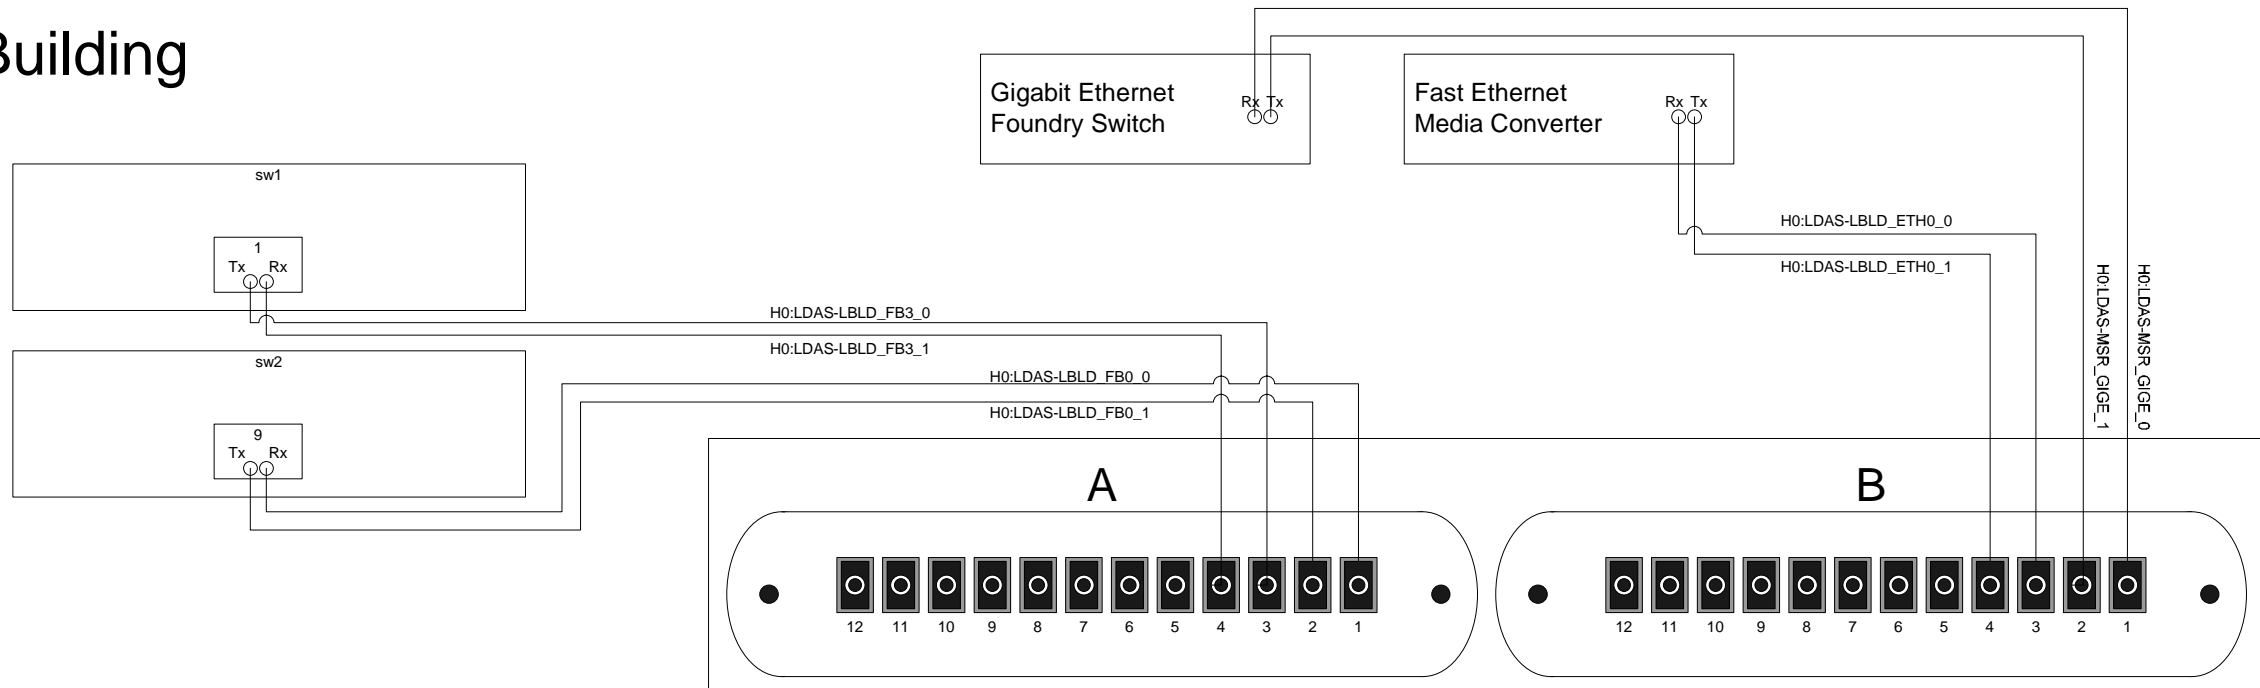

Mass Storage Room, Corner Station

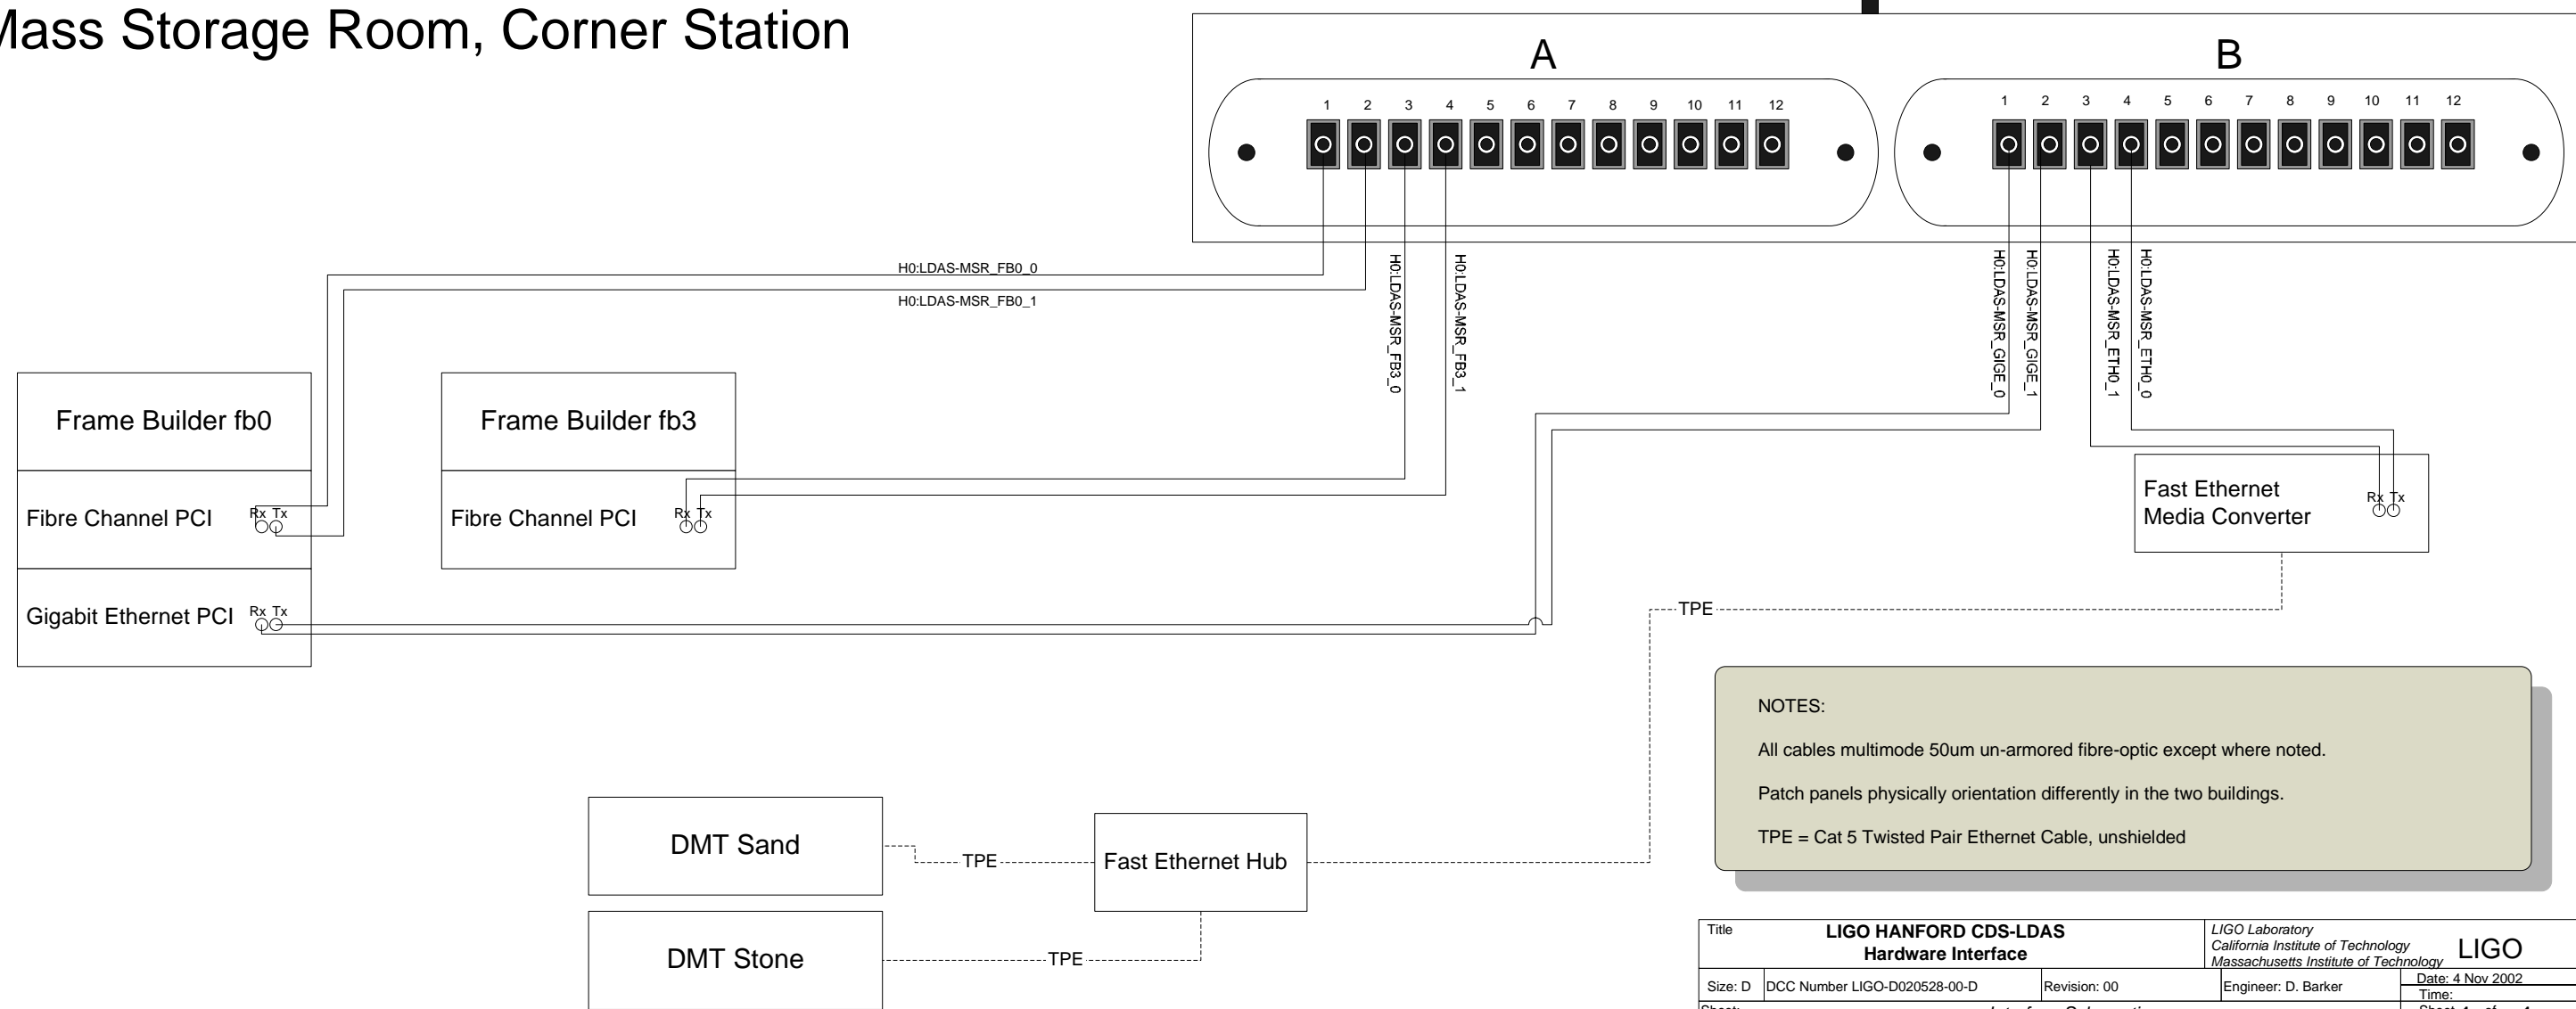

NOTES:
 All cables multimode 50um un-armored fibre-optic except where noted.
 Patch panels physically orientation differently in the two buildings.
 TPE = Cat 5 Twisted Pair Ethernet Cable, unshielded

Title		LIGO HANFORD CDS-LDAS Hardware Interface		LIGO Laboratory California Institute of Technology Massachusetts Institute of Technology		LIGO	
Size: D	DCC Number LIGO-D020528-00-D	Revision: 00	Engineer: D. Barker	Date: 4 Nov 2002	Time:		
Sheet:				<i>Interface Schematic</i>		Sheet 1 of 1	