
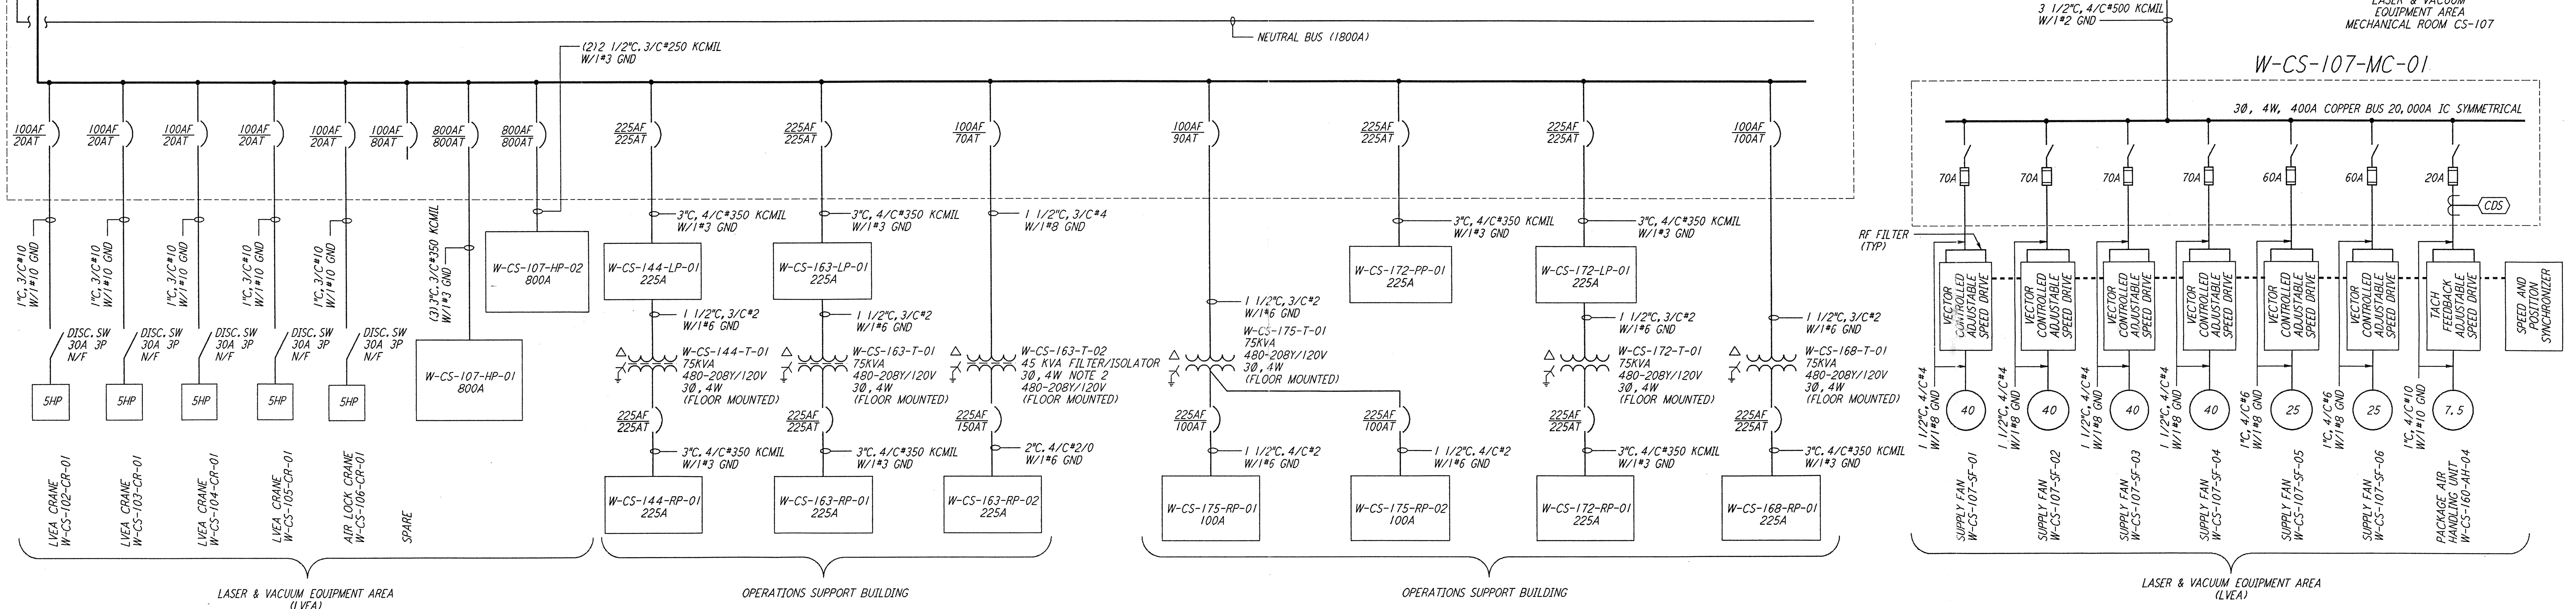


- NOTES:**
- FOR LEGEND AND GENERAL NOTES SEE DWG WA-E-005.
 - TRANSFORMERS FEEDING THE CDSAC PANELS ARE TO BE K-13 RATED AND SHALL INCORPORATE AN INTERWINDING SHIELD, GROUNDED TO THE CASE GROUND. TRANSFORMER ARE TO BE SUITABLE FOR OUTDOOR SERVICE.
 - CDSAC PANELS SHALL HAVE 200% RATED NEUTRAL BUSES.
 - GROUND CONDUCTOR FROM TRANSFORMER NEUTRAL/CASE BOND JUNCTION TO GROUND GRID SHALL BE NO LONGER THAN 4 FT.

**SWITCHBOARD W-CS-107-SB-01
 SQUARE D CLASS 2741**

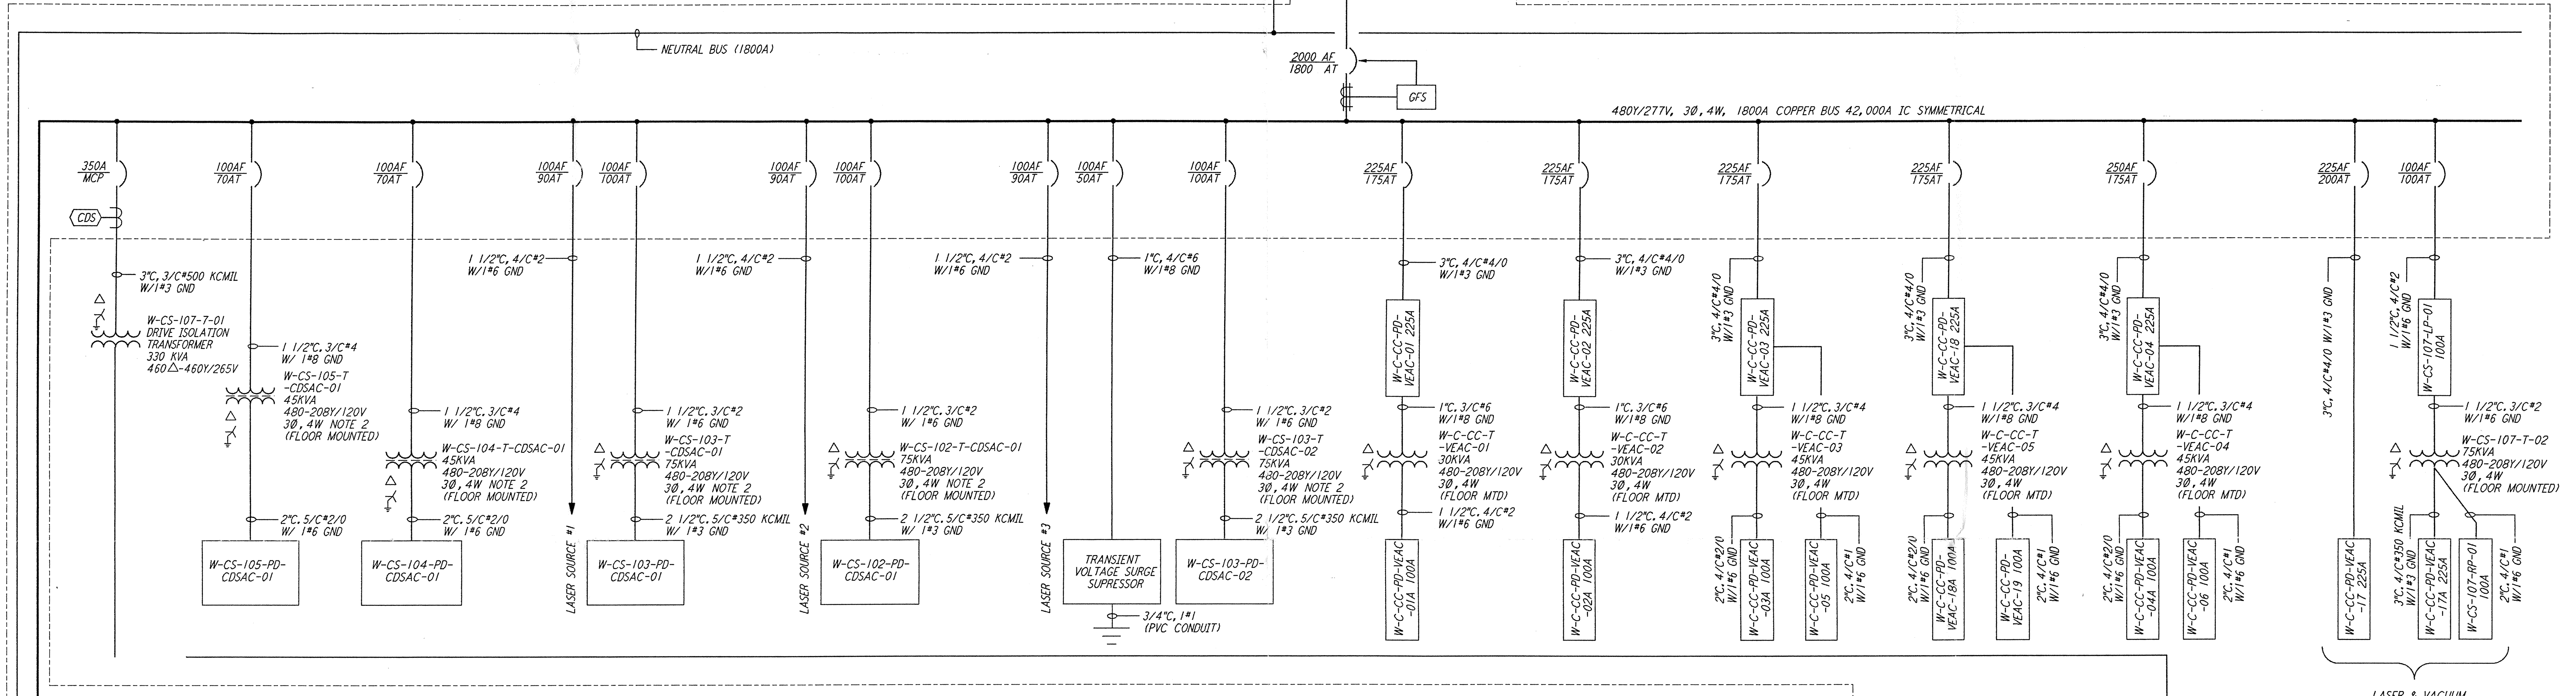

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION
A	4-19-96	J.C.	J.M.	W.H.	EDM	FINAL DESIGN REVIEW & BID

DRAWN	K. R.
CHECKED	
ENGINEER	
PROJ	

100 WEST WALNUT STREET
 PASADENA, CALIFORNIA



100 WEST WALNUT STREET
 PASADENA, CALIFORNIA



CALIFORNIA INSTITUTE OF TECHNOLOGY
 MASSACHUSETTS INSTITUTE OF TECHNOLOGY

**LASER INTERFEROMETER
 GRAVITATIONAL-WAVE OBSERVATORY
 SITE NO. 1 - HANFORD, WASHINGTON**

TITLE	ELECTRICAL CORNER STATION 3RD INTERFEROMETER SINGLE LINE DIAGRAM
SHEET NUMBER	NONE
CONTRACT NUMBER	PP150969
PROJECT NUMBER	8094
REVISIONS	WA-E-502

LIGO-D960431-A-O
 LIGOWAF.BDR