



- ☐ EMERGENCY SHUTDOWN SWITCH (405) (406)
- ⌘ SINGLE POLE LIGHT SWITCH
- ⊕ SURFACE MOUNT DUPLEX RECEPTACLE
- FLUORESCENT LIGHTING FIXTURE


NOTE: SURFACE MOUNT CONDUITS BETWEEN DEVICES AND EQUIPMENT. CONTROL WIRING TO PSIO TO BE INSTALLED BY LIGO. CONTRACTOR SHALL INSTALL LIGO FURNISHED PSIO CABINET.

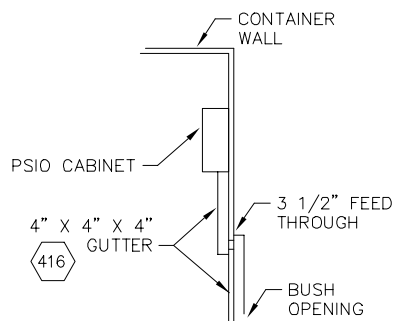


PSIO CABINET GUTTER DETAIL

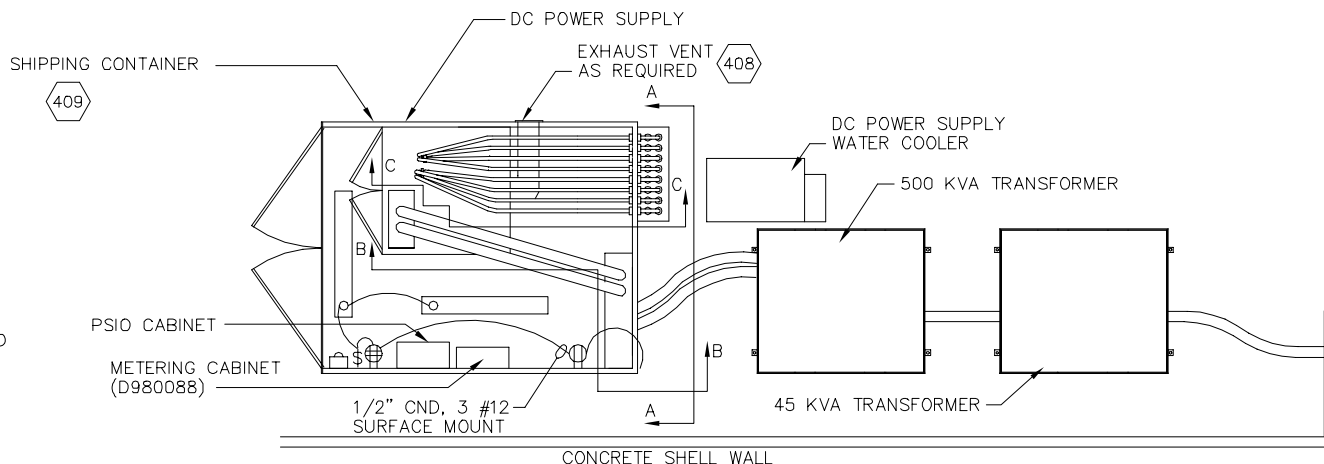


PLAN VIEW DC POWER SUPPLY CONTAINER

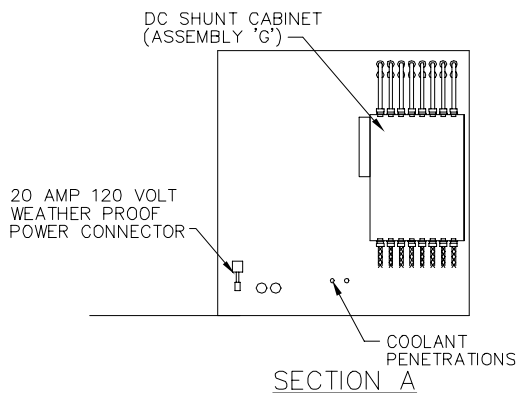

SECTION A

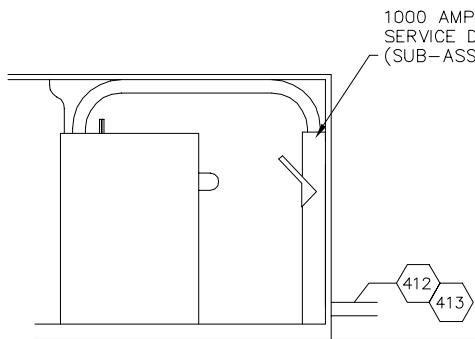

SECTION B

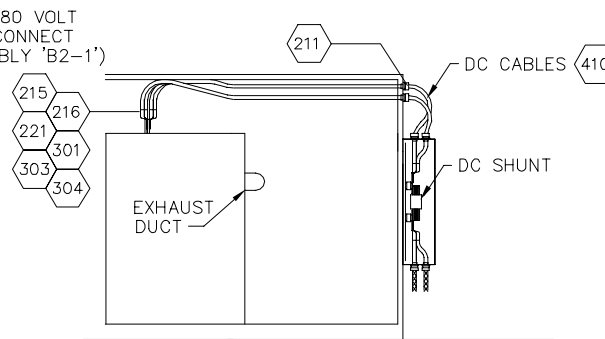

SECTION C